

ACCESSORIES

Models STR-19B & SR-10

Installation/Operation




EN55103-1 E1-E5; EN55103-2 E1-E4


Typical Performance reflects product at publication time exclusive of EMC data, if any, supplied with product. Specifications are subject to change without notice.

Step 1


Attach Narrow Dual-Lock Strip Provided with Stick-On.

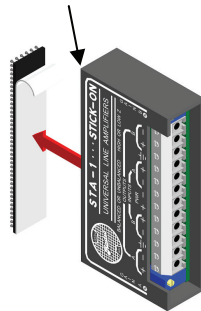

STR-19B Hinged 19-inch Rack Mount Panel

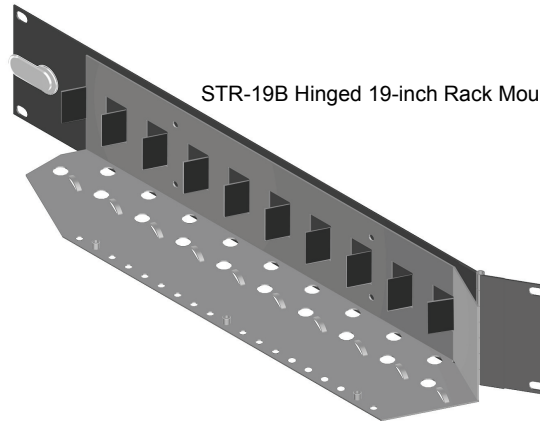


SR-10 Mounting Panel

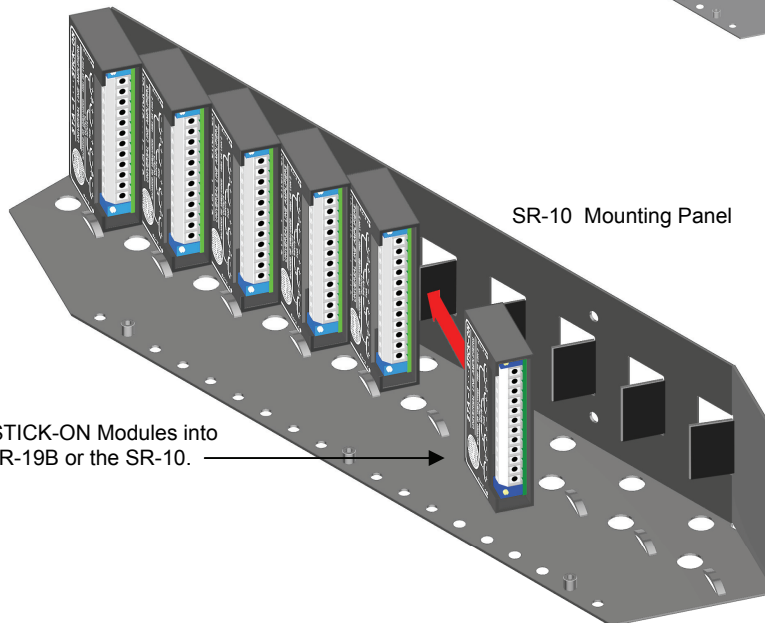

Step 2

Slide STICK-ON Modules into the STR-19B or the SR-10.

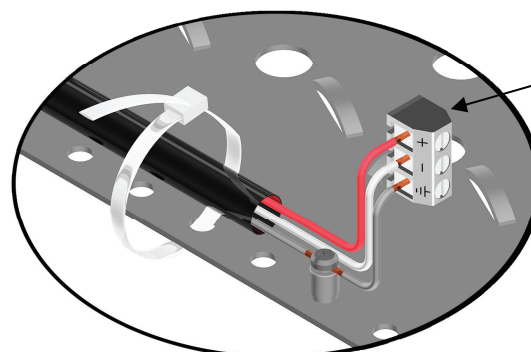

STICK-ON Module Terminal Block

Step 3

Use Cable Ties to Secure Wiring.

Step 4

Connect Shields to Ground Terminal. (normal for inputs, optional for outputs)